


NEUTRAL TO
OP DURING DE-ICE.

BETWEEN INDOOR

TE FIELD WIRING.

OUTDOOR CONDENSING UNIT

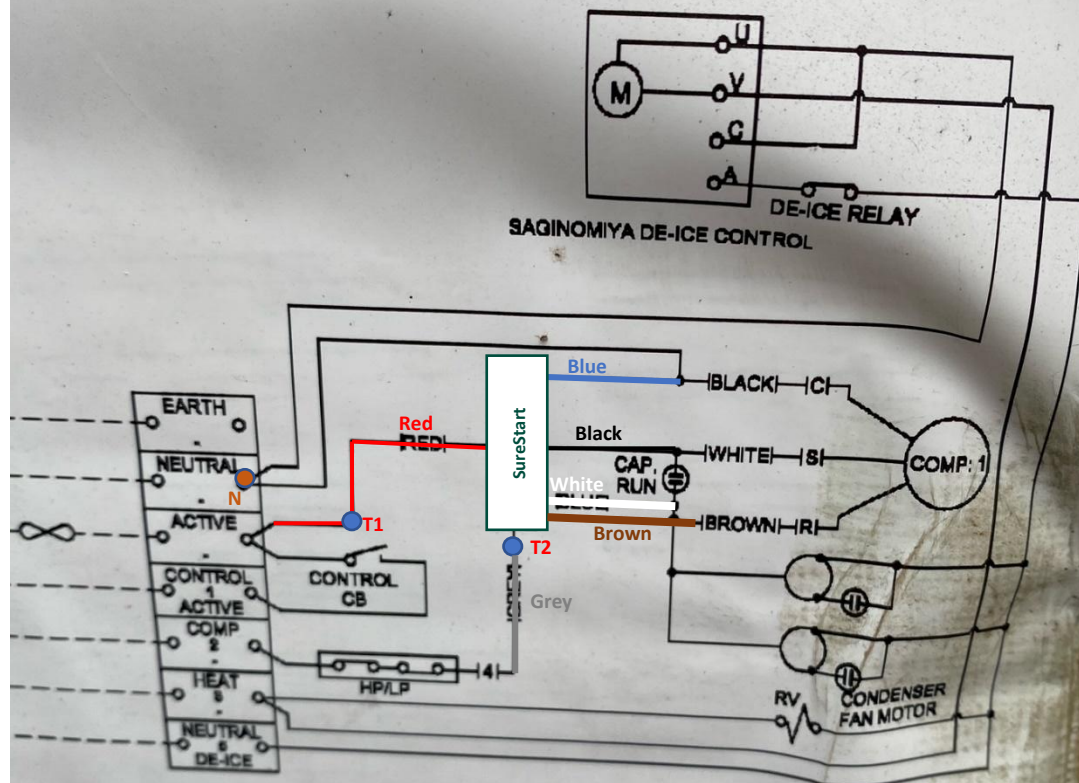

ACCENT
AIR
A HANSON COMPANY

21 Alderson Street
Liverpool NSW 2170
Australia
Phone: +61 2 9602 8444
Fax: +61 2 9602 8477

AEC13 TO AEC17

REF. DWG
AA13-17-E01

Date
13/1/2008

Drawn
B. Fleming

Unit specifications are subject to change without notice.